

Allied Recycled Aggregates

Report Date: Mar 5, 2026
Work Order Date: Feb 26, 2026

Work Order No.: 25-1032.SoilSampling.0008; ver: 2
Reviewed by: Patrick Pravorne

Soil/Aggregate Laboratory Summary

General Location: Allied Recycle proposed 1.5 x 3/4 inch crushed concrete Logged-in by: Evan Kuhn

Photos



Allied Recycled Aggregates

Report Date: Mar 5, 2026

Work Order No.: 25-1032.SoilSampling.0008; ver: 2

Work Order Date: Feb 26, 2026

Reviewed by: Patrick Pravorne

Soil/Aggregate Laboratory Summary


Specification Title: 3/4 recycled washed agg

Sampling Method: ASTM D75 / AASHTO T2 / CDOT CP30

Material Description:

Sample Location: Allied Recycle proposed 1.5 x 3/4 inch crushed concrete

Aggregate Gradation (ASTM C136 / AASHTO T27)

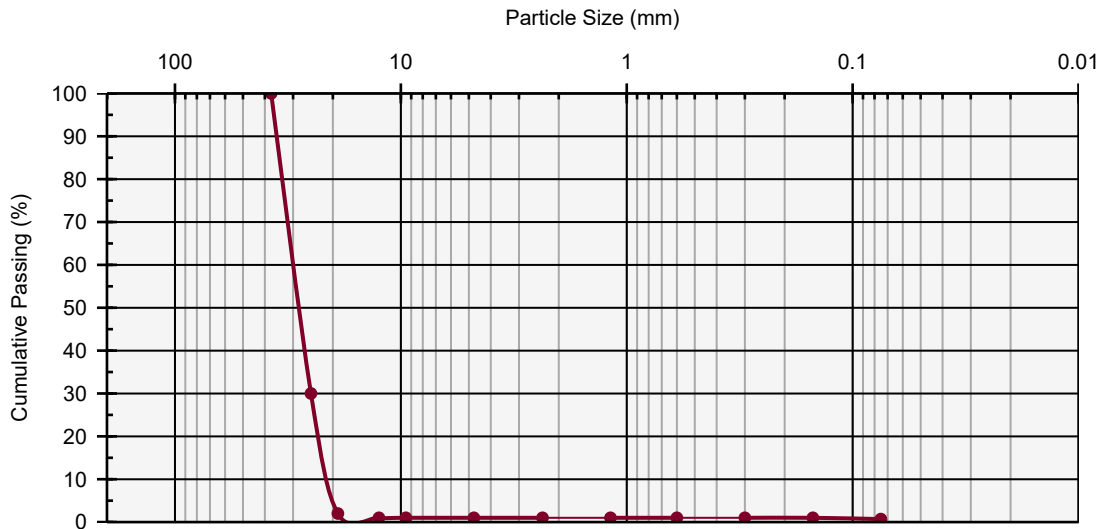

Coarse Gradation				Fine Gradation			
Sieve Size	Particle Size (mm)	Cumulative Passing (%)	Specified (%)	Sieve Size	Particle Size (mm)	Cumulative Passing (%)	Specified (%)
6 in	150	-	-	No. 4	4.75	1	-
5 in	125	-	-	No. 8	2.36	1	-
4 in	100	-	-	No. 10	2.00	-	-
3.5 in	90	-	-	No. 16	1.18	1	-
3 in	75	-	-	No. 20	0.85	-	-
2.5 in	63	-	-	No. 30	0.60	1	-
2 in	50	-	-	No. 40	0.425	-	-
1.5 in	37.5	100	-	No. 50	0.300	1	-
1 in	25.0	30	-	No. 60	0.250	-	-
3/4 in	19.0	2	-	No. 80	0.180	-	-
1/2 in	12.5	1	-	No. 100	0.150	1	-
3/8 in	9.5	1	-	No. 140	0.090	-	-
No. 4	4.75	1	-	No. 200	0.075	0.7	-

Results apply only to the specific items and locations referenced and at the time of testing, observations or special inspections. Unless noted otherwise, samples were received in adequate condition. This report should not be reproduced, except in full, without the written permission of GROUND Engineering Consultants, Inc.